


Nominal Dimension L	General tolerance				
	Fine	Middle	Coarse	Radius	Angle
0.5 ≤ L ≤ 3	±0.05	±0.1	±0.2	±0.3	±20°
3 < L ≤ 6	±0.05	±0.1	±0.2	±0.8	±20°
6 < L ≤ 30	±0.1	±0.2	±0.5	±2	±4.0°
30 < L ≤ 120	±0.15	±0.3	±0.6	±3	±1°
120 < L ≤ 315	±0.2	±0.5	±1.2	±5	±2°
315 < L ≤ 1000	±0.3	±0.8	±2	±10	±2°
1000 < L	±0.5	±1.2	±3	±20	±2°

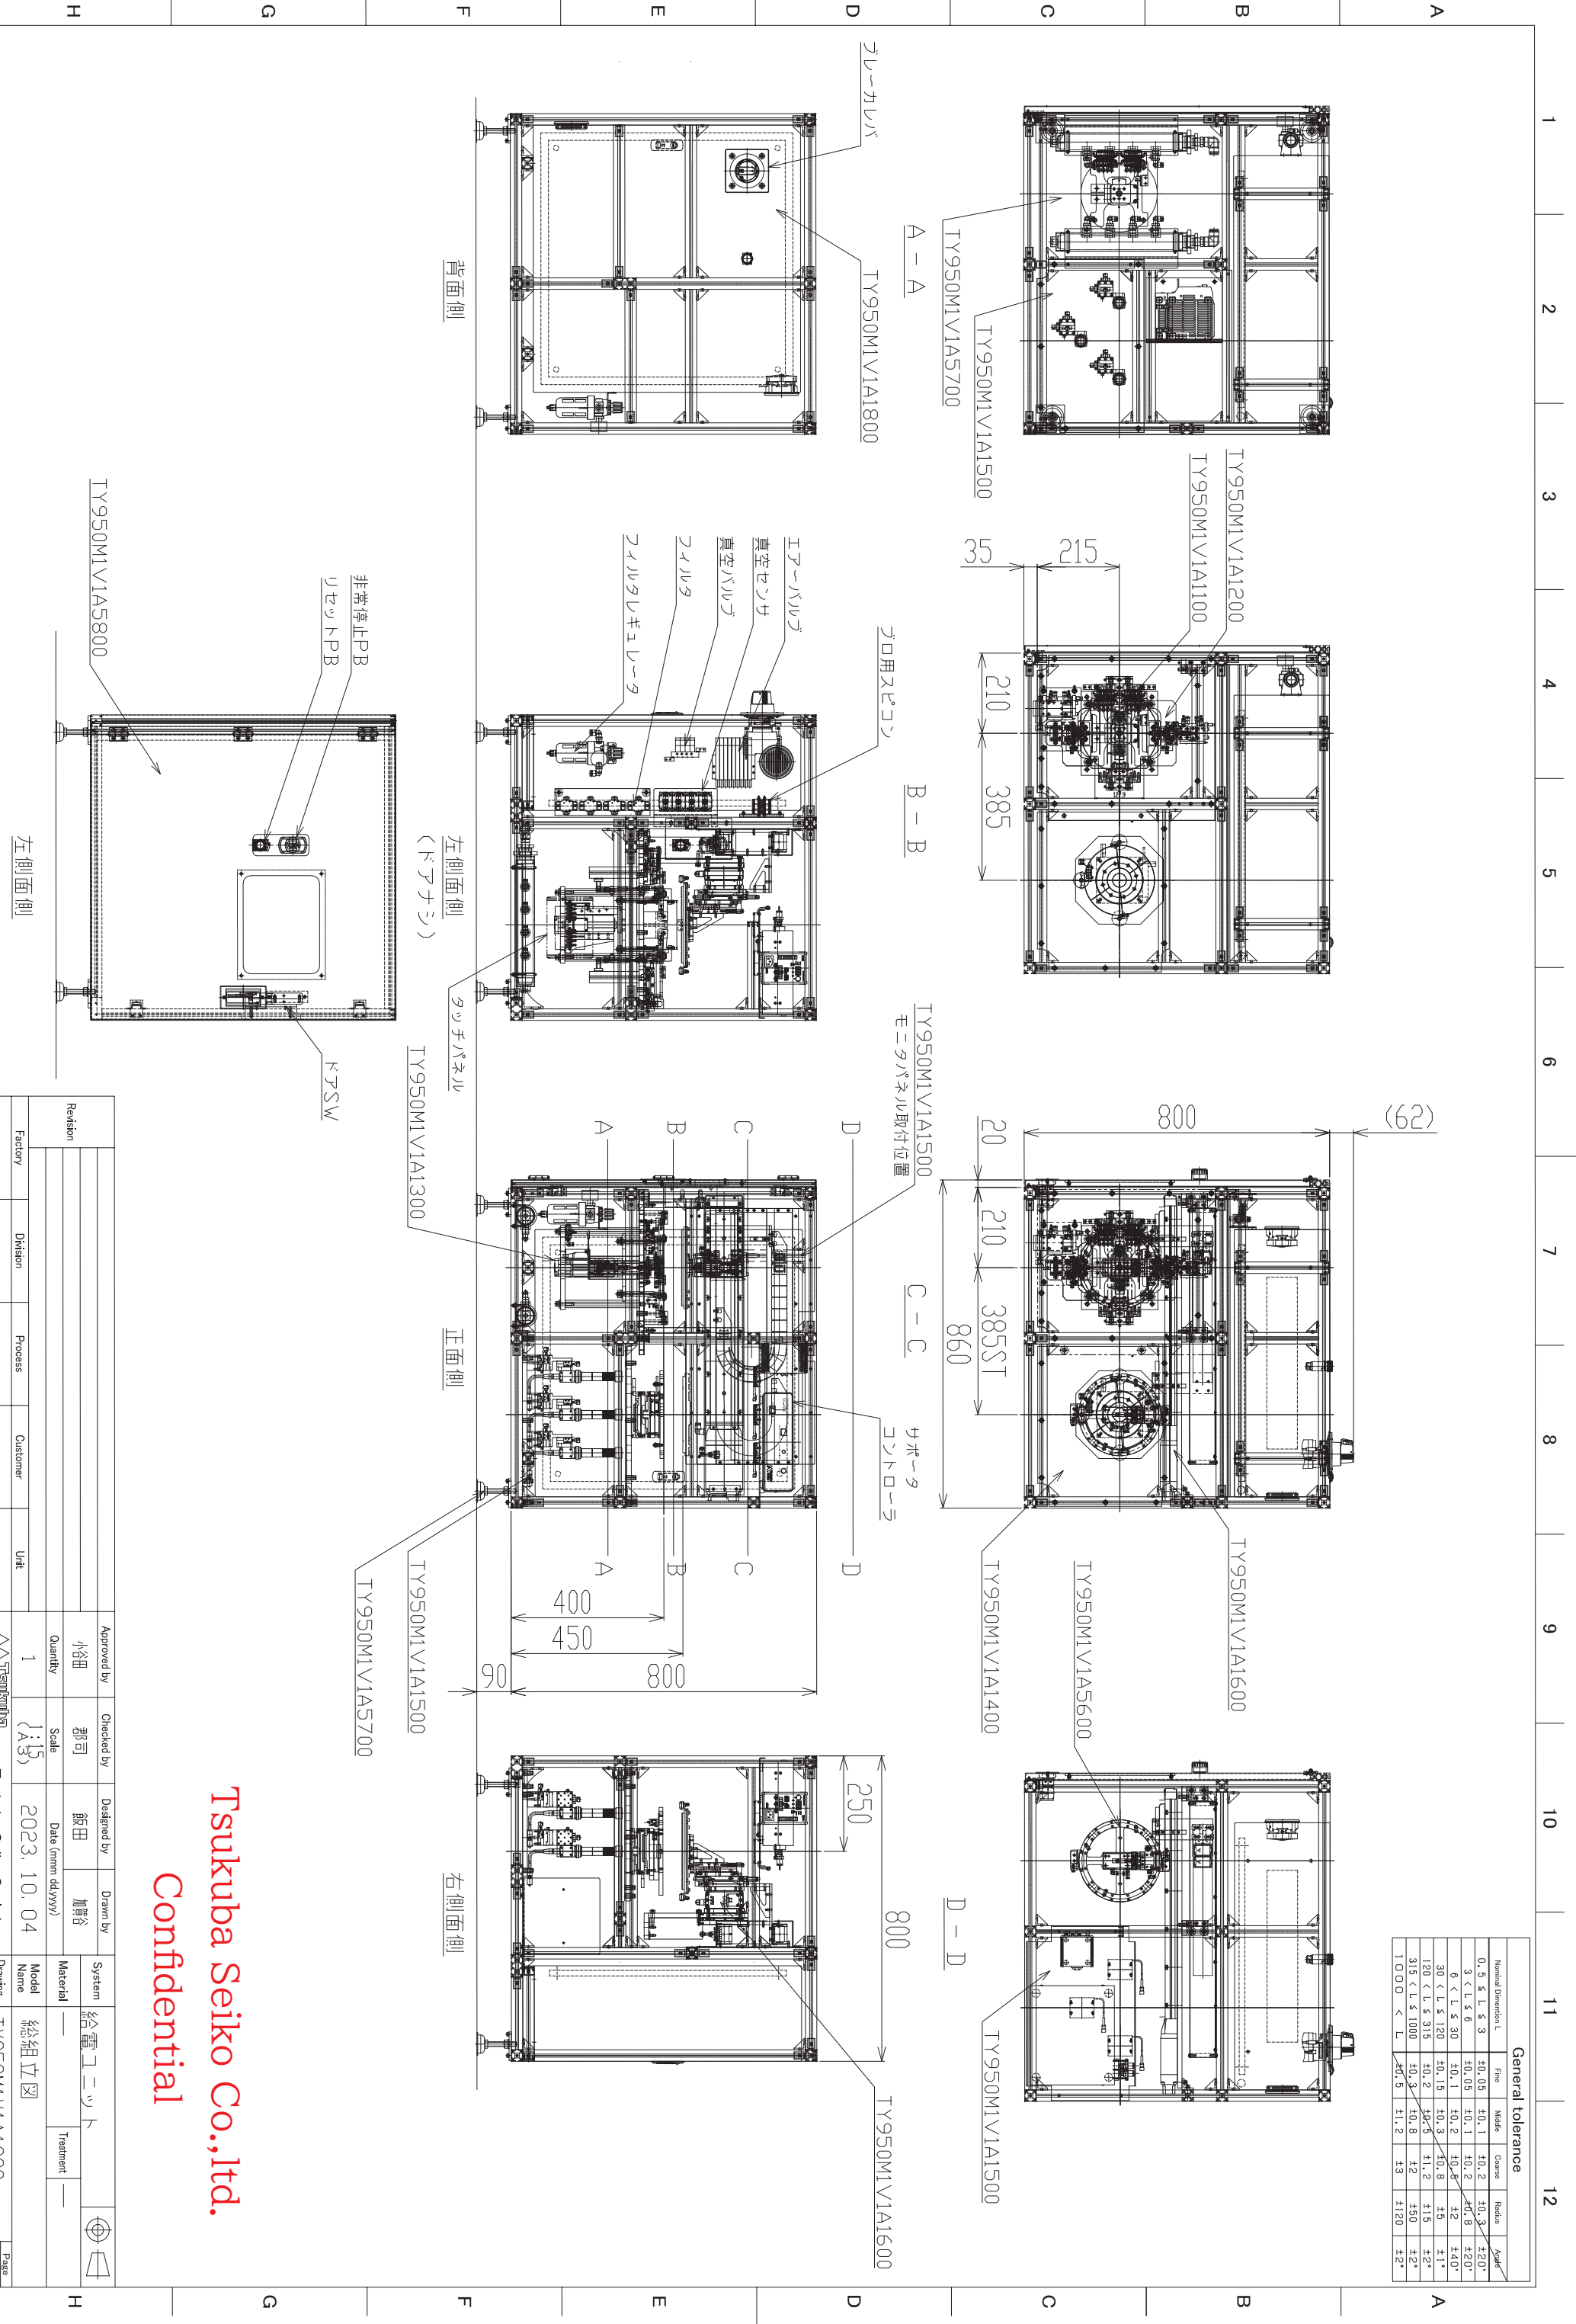

Tsukuba Seiko Co.,Ltd.
Confidential

Revision	Factory	Division	Process	Customer	Unit	Approved by 小谷田	Checked by 郡司	Designed by 飯田	Drawn by 加賀谷	System 給電ユニット
						Quantity 1	Scale (A3)	Date (mm/dd/yyyy) 2023. 10. 04		Treatment
Tsukuba Seiko Co.,Ltd.						Tsukuba Seiko		Tsukuba Seiko Co.,Ltd.		Model Name 総組立図
						Drawing No. TY950M1V1A1000				Page 1/1